



食物環境衛生署
Food and Environmental
Hygiene Department

香港金鐘道六十六號金鐘道政府合署四十五樓
45/F, Queensway Government Offices, 66 Queensway, Hong Kong
電話 Tel : 2867 5795 傳真 Fax : 2530 1368

Your Ref. : CB4/PAC/R73
Our Ref. : FEHD CI&PC/32-60/10/11C

By fax 2543 9197 and e-mail
(ahychu@legco.gov.hk, kmho@legco.gov.hk, pkwlai@legco.gov.hk)

香港中環
立法會道
立法會綜合大樓
政府帳目委員會秘書
朱漢儒先生

朱先生：

政府帳目委員會
審議審計署署長第七十三號報告書第 1 章

食物環境衛生署規劃、設置和管理公廁的工作

2019 年 12 月 3 日來函收悉，我們的回覆詳載於下文各段。

(a)(i)

2. 《公廁標準設施手冊》(《手冊》)只備有英文本，詳見英文覆函附件 1a。

(a)(ii)

3. 雖然過去 5 年《手冊》內容並無修訂和更新，但食物環境衛生署(食環署)一直有定期檢討公廁的標準設施及設計，以便規劃公廁的建造、重置及翻新工程。食環署已分別於 2016 年 4 月及 2018 年 8 月制定和發出《長者優先廁格及通用廁所設計指引》及

《新建／翻新公廁改良的設計功能／要求／裝置》兩套內部指引，以補充《手冊》的內容。這兩套指引只備有英文本，詳見英文覆函附件 1b 及 1c。食環署現正與建築署檢視及更新《手冊》的內容，以期把公廁的所有最新設施及標準一併納入《手冊》。

(a)(iii)

4. 食環署在規劃公廁的建造、重置和翻新工程時，會在切實可行範圍內盡量參照《手冊》及上述兩套補充指引的標準與準則，同時會考慮施工技術可行性、實際環境、可用空間、使用率和地區意見。過去 5 年(2015-16 至 2019-20 年度)，新建、重置或翻新的公廁共有 97 個，按年度劃分的分項數字載於附件 2。

5. 在過去 5 年新建／重置的 24 個公廁，全部符合 1:2 的男女廁格比例，並設有暢通易達而無分性別的廁所。

6. 至於在過去 5 年翻新的 73 個公廁中，有 19 個未能符合 1:2 的男女廁格比例，主要是由於空間限制和男廁有相當高的使用率。有 13 個公廁基於實際環境限制及地區人士反對而沒有設置暢通易達而無分性別的廁所。

7. 為長者提供優先廁格及通用廁所設計的指引(在 2016 年 4 月發出)，已應用於 18 個翻新公廁計劃(男廁或女廁設有 4 個或以上廁格)，這些計劃的設計方案自 2016 年 7 月起提交提升公廁工作小組審批。基於實際環境限制和高使用率，在這 18 個翻新的公廁中，2 個沒有設置長者優先廁格，14 個沒有提供通用廁所。

(b)

8. 食環署及其工程代理人（即建築署或其他工務部門）在推行公廁工程項目時，除參照《手冊》及有關指引外，亦會根據屋宇署發出的《設計手冊：暢通無阻的通道 2008》所載的設計規定，為公廁提供無障礙設施。《設計手冊：暢通無阻的通道 2008》載於附件 3。

***委員會秘書附註：有關附件 3，請參閱屋宇署網頁。**

(c)

9. 《公眾衛生及市政條例》(第 132 章) 有關設置、規管、保養、管理和監督公廁和旱廁的相關條文，載於附件 4a 及 4b。

(d)

10. 附件 5a 載列沒有設置自動感應式視液機、水龍頭和沖廁系統的公廁數目及地點。所有旱廁均不設自動感應式視液機和沖廁系統，設有感應式水龍頭的旱廁一覽表載於附件 5b。

11. 根據《手冊》的規定，如實際情況許可，應在水廁廁格和尿廁安裝感應式沖廁系統。如未能在水廁廁格安裝感應式沖廁系統，則應安裝手動按鈕式沖廁裝置，而非腳踏式裝置。如因實際情況而未能在尿廁安裝感應式沖廁系統，則應採用自動沖廁系統。此外，根據《手冊》的指引，大部分公廁都設有嵌入式視液機。食環署在 2018 年 8 月發出有關《新建／翻新公廁改良的設計功能／要求／裝置》的內部指引，所有在此之後新建／重置／翻新的公廁都設有自動感應式視液機。就新建／重置／翻新的公廁而言，我們會在切實可行範圍內盡量提供自動感應式視液機、水龍頭及沖廁系統。

(e)

12. 過去 5 年公廁及旱廁的犯罪個案舉報數字，載於附件 6。

(f)

13. 食環署自 2000 年起推行公廁翻新計劃，每年篩選特定數目的公廁進行翻新工程。食環署會通盤考慮相關準則，以訂定納入計劃的公廁名單。翻新的優次會按下列準則訂定：

- (a) 設計過時且未曾進行過大規模翻新的公廁；
- (b) 使用率高的公廁；
- (c) 位於熱門風景區或旅遊景點的公廁；及
- (d) 內部情況／損耗狀況欠佳的公廁。

***委員會秘書附註：有關附件 4a，請參閱《公眾衛生及市政條例》(第 132 章) – 第 36 條"公共廁所及浴室的提供和經辦"。有關附件 4b，請參閱《公廁(行為及舉止)規例》(第 132BL 章)。**

14. 就(a)項而言，我們會評估未曾根據公廁翻新計劃進行翻新或長期沒有翻新的公廁是否設計過時，一般會考慮公廁落成或上一次翻新距今的時間。就(b)項而言，平均每日使用人次達到或高於300的公廁會獲界定為使用率高。食環署自2019年年初起逐步以紅外線感應方式取代人手點算，以評估使用公廁的人次。就(c)項而言，我們會考慮位於著名旅遊景點及業界和地區人士建議的公廁，以及旅遊事務署的意見。就(d)項而言，負責定期巡查的分區人員會就公廁內的情況／損耗狀況作出實地評估。

(g)

15. 為改善衛生情況，並提供更方便市民使用的公廁設施，食環署不斷在翻新計劃引入新設施和新科技。一般而言，採用新設施及科技的工作流程如下：

- ◆ 食環署透過互聯網、接觸業界、本港的研究及發展機構，以及實地視察等途徑，探索新設施及科技；
- ◆ 食環署進行調查和市場研究，探討把新設施及科技應用於公廁的成本效益和可行性；
- ◆ 食環署在適當情況下就技術可行性諮詢相關部門，特別是建築署和機電工程署；
- ◆ 食環署在選定的公廁進行試驗計劃；以及
- ◆ 如效果令人滿意，食環署便把相關科技的試驗規模擴大至涵蓋更多公廁，待評估效果後全面推行。

(h)

16. 建築署負責公廁和旱廁建造、重置及翻新計劃的基本工程，並會向政府帳目委員另行提供有關資料。

(i)

17. 由食環署員工及承辦商提供潔淨服務的公廁，巡查頻次指引載於附件7。

(j)(i)、(ii)及(iii)

18. 截至 2019 年 12 月 1 日，有效的外判街道潔淨服務合約共有 34 份，當中涵蓋公廁及早廁的潔淨服務。每次招標均接獲 2 至 6 份標書，分項數字載於附件 8。

19. 為落實行政長官在 2018 年 10 月公布的新政策，食環署就 2019 年 4 月 1 日或以後招標採購的街道潔淨服務(當中包括公廁及早廁的潔淨服務)合約優化評分制度，加強保障非技術員工。具體而言，評分制度下技術審核的比重由 30% 增至 50%；技術審核中非技術工人工資水平的比重由 16% 增至 25%。在 2019 年 12 月 1 日當天有效的 34 份合約中，有 8 份在 2019 年 4 月 1 日或以後進行招標，並採用了經優化的評分制度。由這些外判服務合約的中標者所僱用的廁所事務員，平均承諾每月工資約為 12,810 元，較引進優化評分表前已招標的其他合約的平均承諾每月工資約 10,610 元高出約 20%。

食物環境衛生署署長

(潘炳揚



代行)

副本送：食物及衛生局局長(傳真號碼 2526 3753)

建築署署長(傳真號碼 2877 0594)

旅遊事務專員(傳真號碼 2801 5792)

財經事務及庫務局局長(傳真號碼 2147 5239)

審計署署長(傳真號碼 2583 9063)

2019 年 12 月 11 日

Handbook on Standard Features for Public Toilets

**Planning & Development Section
Food and Environmental Hygiene Department
December 2011**

*** 委員會秘書附註：本文件只備英文本。**

TABLE OF CONTENTS

		<u>Page</u>
CHAPTER 1	OVERVIEW	
1.1 – 1.2	Planning Guidelines	1
1.3	New Construction Projects and Re provisioning Projects	1
1.4	Refurbishment of Public Toilets	1
1.5	Conversion of Aqua Privies into Flushing Toilets	1
1.6	Compliance with Barrier Free Access Requirements	1
1.7	Compliance with Smoking (Public Health) Ordinance (Cap. 371)	2
CHAPTER 2	EXTERNAL DESIGN OF PUBLIC TOILET	
2.1 – 2.5	General Layout	3
2.6 – 2.8	Outlook	3 – 6
2.9	External Lighting	6
2.10	Cat Ladder	7
CHAPTER 3	INTERNAL DESIGN OF PUBLIC TOILET – TOILET COMPARTMENT AND URINAL	
3.1 – 3.4	Toilet Compartments in Male and Female Toilets	
3.1 (3.1.1)	Provision of Toilet Compartments in Male and Female Toilets	8
3.2 (3.2.1 – 3.2.2)	Provision of Pedestal and Squatting Types Water Closets	8
3.3 (3.3.1 – 3.3.13)	General Design of Water Closet (WC) Compartments	9 – 13
3.4 (3.4.1 – 3.4.3)	Baby Rest	13
3.5	Urinals in Male Toilets	
(3.5.1 – 3.5.7)	Provision of Urinals in Male Toilets	13 – 15

3.6	Flushing System	
3.6 (3.6.1 – 3.6.6)	Flushing System for Toilet Compartments and Urinals	15 – 16
3.7 – 3.14	Accessible Unisex Toilet	16 – 19
CHAPTER 4	INTERNAL DESIGN OF PUBLIC TOILET – COMMUNAL AREA	
4.1 – 4.9	Internal Fitting-out	
4.1 (4.1.1 – 4.1.8)	Wash Hand Basin and Vanity Benchtop	20 – 22
4.2 (4.2.1 – 4.2.4)	Mirror	22 – 23
4.3 (4.3.1 – 4.3.4)	Water Tap	23 – 25
4.4 (4.4.1)	Soap Dispenser	25
4.5 (4.5.1– 4.5.2)	Make-up Corner	25 – 26
4.6 (4.6.1 – 4.6.6)	Baby Changing Counter and Baby Changing Room	26 – 28
4.7 (4.7.1 – 4.7.5)	Attendant Room	28 – 29
4.8 (4.8.1 – 4.8.4)	Slop Sink/ Mop Sink	29 – 31
4.9 (4.9.1 – 4.9.7)	Other Provision	31 – 34
4.10 – 4.13	Internal Finishing and Colour Scheme	
4.10 (4.10.1 – 4.10.3)	Wall	34
4.11 (4.11.1 – 4.11.4)	Floor	34 – 35
4.12 (4.12.1 – 4.12.2)	Ceiling	35
4.13 (4.13.1)	Internal Colour Scheme	35 – 36
4.14	Materials with Properties that Can Retard Bacteria Growth	37
4.15 – 4.17	Lighting	37 – 38

4.18 – 4.20	Sightlines	38 – 39
4.21 – 4.22	Service Passage or Walk-in Services Ducts	39
CHAPTER 5	DRAINAGE AND VENTILATION	
5.1 – 5.2	Prevention of Wet Floors	
5.1 (5.1.1)	Blower Fan	40
5.2 (5.2.1 – 5.2.3)	Drainage	41 – 42
5.3 – 5.5	Ventilation and Odour Control	
5.3 (5.3.1 – 5.3.3)	Ventilation	42 – 43
5.4 (5.4.1 – 5.4.3)	Odour Control	43 – 44
5.5 (5.5.1 – 5.5.2)	Others	44 – 45
CHAPTER 6	SIGNAGE	
6.1 – 6.4	Toilet Title on External Wall	46 – 47
6.5 – 6.10	Illuminated Sign Box/ Wall-mounted Sign on External Wall	47 – 49
6.11	Composite Sign	49 – 50
6.12 – 6.24	Information Sign	51 – 57
6.25 – 6.27	Others	57 – 58
6.28	Compliance with Barrier Free Access Requirements	58
APPENDIX	Points to Note for Construction/ Reprovisioning/ Refurbishment/ Conversion Projects	59 – 60

CHAPTER 1

OVERVIEW

Planning Guidelines

- 1.1 The Hong Kong Planning Standard and Guidelines do not specify the criteria for the provision of public toilets on a population basis or any other basis.
- 1.2 In general, consideration would be given to providing public toilets at tourist spots and locations with anticipated high patronage rate and without adequate alternative toilet facilities in the vicinity (e.g. toilets within public/commercial venues like parks, playgrounds or shopping arcades) to serve the public/tourists.

New Construction Projects and Re provisioning Projects

- 1.3 It is the onus of user sections to critically examine and fully justify the need for new or re provisioned public toilets having regard to all relevant factors including but not limited to existing and anticipated patronage rate, availability of similar facilities in the vicinity, etc.

Refurbishment of Public Toilets

- 1.4 FEHD has implemented a Public Toilet Refurbishment Programme since 2000 to bring new looks to public toilets with enhancement in design and facilities. The Programme is ongoing with funding from Block Vote 3004GX under ArchSD's control.

Conversion of Aqua Privies into Flushing Toilets

- 1.5 Since 2005, FEHD has been converting aqua privies (i.e. village-type dry latrines) into flushing toilets under a phased programme, with the final phase scheduled tentatively to be completed in 2013.

Compliance with Barrier Free Access Requirements

- 1.6 Provision of male toilet, female toilet and accessible unisex toilet should comply with the requirements in the prevailing "Design Manual – Barrier Free Access" issued by Buildings Department and other legislation and codes of practice relating to barrier free access.

Compliance with Smoking (Public Health) Ordinance (Cap. 371)

- 1.7 In accordance with the Ordinance, public indoor places are designated as no smoking areas. Smoking is therefore prohibited in public toilets. No ash trays should be provided in the toilets.

CHAPTER 2

EXTERNAL DESIGN OF PUBLIC TOILET

General Layout

- 2.1 Public toilets normally comprise a male toilet, a female toilet and an accessible unisex toilet.
- 2.2 All toilets should be provided at ground floor level. If female and male toilet facilities cannot be provided on the same floor due to site or other constraints, female toilet should be located on the ground floor or lower floor as far as possible.
- 2.3 If both male toilet and female toilet are required to be located on upper floor level due to site constraint, separate entrances at ground floor level should be provided for male toilet and female toilet as far as practicable.
- 2.4 The accessible unisex toilet should normally be at ground floor level. If not, it should be accessible by wheelchair users with special designs (i.e. an accessible route should be provided for wheelchair users by provision of an accessible ramp or lift).
- 2.5 If a public toilet is located inside a building, it should be located at areas with natural ventilation and natural lighting available as far as practicable.

Outlook

- 2.6 The external outlook should match with the surrounding environment and give an image of public toilet as a healthy, clean, safe and decent public facility.
- 2.7 Feature wall on the exterior should be considered for the public toilets in tourist areas to create a lively atmosphere.

Example (1) : - External colour scheme and design to match with the surrounding environment



Tui Min Hoi (Chui Tong) Public Toilet (Sai Kung)



Tai Po Old Market Public Toilet (Tai Po)

Example (2) : - Modern external design



Lantau Link Viewing Platform Public Toilet (Kwai Tsing)

Example (3) : - Use of feature wall for external wall design



Ngong Ping Road Interchange Public Toilet (Islands)

- 2.8 Finishing materials for external walls should be easy to maintain and easy for cleansing as far as possible. Due care should be taken in the use of reflective materials to avoid causing nuisance to nearby residents.


External Lighting

- 2.9 Decorative feature lighting should be introduced to enhance illumination to the external elevation of the toilet. The installation should take into account the need to protect the environment and to minimise lighting impact on nearby residents with appropriate measures introduced (e.g. adjusting the angle of the external lights, using lamp shades, directing external lights downwards, etc.).



Decorative
feature
lighting on
external
walls

Lantau Link Viewing Platform Public Toilet (Kwai Tsing)

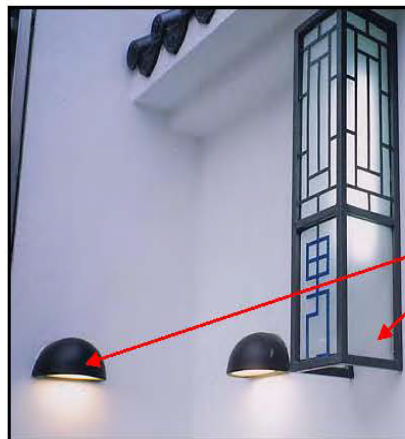

Decorative
feature lighting
on external walls

Fong Ma Po Public Toilet (Tai Po)

Cat Ladder

- 2.10 Cat ladder will be provided for access to the roof-top for inspection/maintenance of water tank if necessary. Cat ladder should be placed at external wall of male toilet and far away from windows/louvers of female toilet as far as possible. Cat ladder should also be placed far away from the windows and balconies of adjacent buildings that are very close to the public toilet.

CHAPTER 3

INTERNAL DESIGN OF PUBLIC TOILET - TOILET COMPARTMENT AND URINAL

Toilet Compartments in Male and Female Toilets

3.1 Provision of Toilet Compartments in Male and Female Toilets

3.1.1 The ratio of 1 male to 2 female toilet compartments should be used as a general guideline, unless otherwise specified. The actual number of toilet compartments should depend on site condition, space availability, usage pattern and operational need.

3.2 Provision of Pedestal and Squatting Types Water Closets

3.2.1 Both pedestal and squatting types water closets should be provided. Generally, the ratio of 1 pedestal type water closet to 1 squatting type water closet should be adopted. The actual number of pedestal and squatting type water closets should depend on site condition, space availability, usage pattern and operational need. Consideration should be given to providing more pedestal type water closets in public toilets at tourist spots to cater for the needs of overseas tourists.



Pedestal type water closet




Squatting type water closet

Kam Tin Market Public Toilet (Yuen Long)

3.2.2 When eight or more male or female toilet compartments are provided, one of the pedestal type water closets should be at children-height level, i.e. about 300mm to 350mm from finished floor level. The actual provision should depend on site condition, space availability, usage pattern and operational need.

3.3 General Design of Water Closet (WC) Compartments

- 3.3.1 Internal area for each WC compartment should measure 900mm wide and 1700mm long between finished wall surfaces. The length can be reduced to 1500mm if water cistern is installed in the service passage or walk-in service duct behind the WC compartment.
- 3.3.2 Compartments are enclosed by proprietary partitions and doors. Water resistant and durable materials of colours matching with the internal environment should be used.
- 3.3.3 Compartment doors and partitions shall not exceed 100mm clear above finished floor level. Actual clearance above finished floor level should take into consideration cleansing, ventilation and sightline concerns.
- 3.3.4 The compartment partitions should measure 2400mm in height (not including the actual clearance above finished floor level), subject to a minimum clearance of 140mm between the ceiling and the top of compartment partitions. For toilets with higher than usual ceilings, leaving significant space between the top of the partition and ceiling, the partition should be extended as appropriate or horizontal railings (which should be in tubular shape and of about 25mm to 38mm in diameter) should be added above the compartment partitions. The spacing between tubular railings and top of the partition should not be more than 125mm (measured from centre of the tubes).
- 3.3.5 The compartment doors should measure 1830mm in height (not including the actual clearance above finished floor level). Pilasters should be of the same height as the compartment partitions (i.e. should measure 2400mm in height, not including the actual clearance above finished level), two horizontal tubular railings (of about 25mm to 38mm in diameter) not more than 125mm apart (measured from the centre of the tubes) should be added above the compartment door.
- 3.3.6 Railings, supporting frame, hinges, locks and legs for cubicle partitions & compartment doors should be of colours matching with the toilet cubicle door/partition. They should also be durable against corrosion and heavy usage.
- 3.3.7 Notwithstanding that squatting type cubicle is provided, flat floor design throughout the toilet should be adopted if circumstances permit. In case of technical or site constraint, localized raised floor design should be adopted with steps to tackle the level difference. Warning strips should be added along the edge of the steps to alert toilet users.

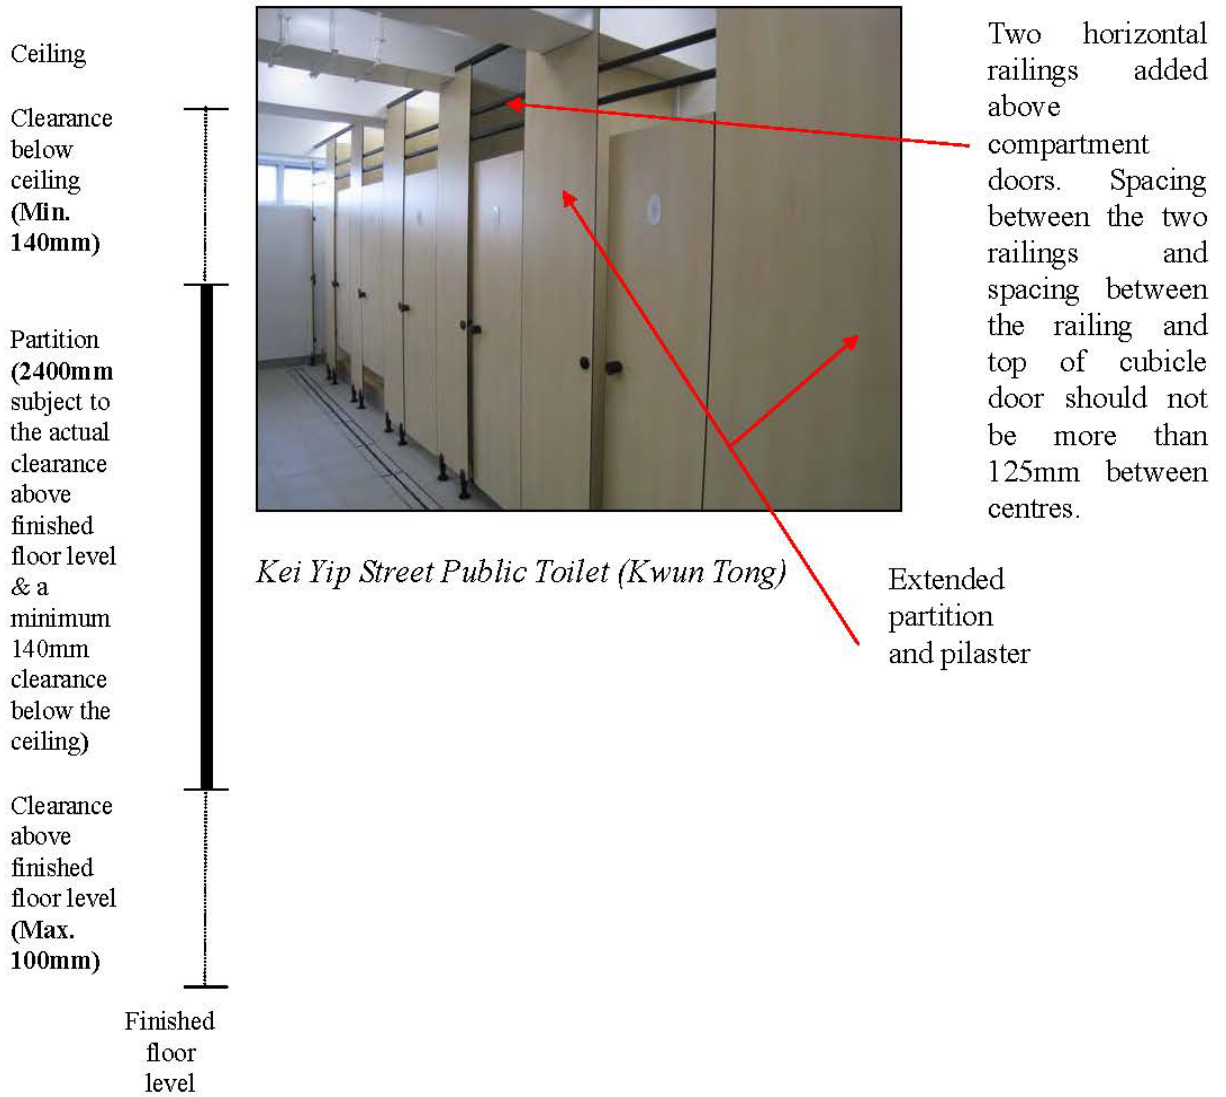

- 3.3.8 Hand-grip rails in white colour coating should be provided on both sides of squatting type and pedestal type toilets to assist the elderly and health impaired persons.
- 3.3.9 Hand-grip rails should measure 750mm above finished floor level for the higher end (near the cubicle door) and 550mm above finished floor level for the lower end (near the rear of the cubicle) for squatting type toilets.
- 3.3.10 Hand-grip rails should measure 850mm above finished floor level for the higher end (near the cubicle door) and 650mm above finished floor level for the lower end (near the rear of the cubicle) for pedestal type toilets.



Hand-grip rails in white colour coating on both sides of the pedestal type toilet

In Ku Lane Public Toilet (Central/Western)

3.3.11 The following small fittings should be provided in each toilet compartment –

- (i) Door stoppers at about 200mm above the finished floor level, either at compartment doors or compartment partitions
- (ii) Coat hook at about 500mm below the top of the cubicle door, and in a colour matching with the partition/door of the WC compartment and other accessories like hinges, locks, legs, etc.
- (iii) A slanted semi-circular protective cover/ledge above the coat hook rendering a narrow gap of 50mm between the two. The dimensions of the cover/ledge should be 50mm in radius and 12mm to 13mm thick. The cover/ledge should be made of solid surfacing material (e.g. “Corian”, “Surrell” or other similar materials) in a matching colour with vanity benchtop or compartment partitions/doors. The design of the cover/ledge and coat hook should be compatible with each other.
- (iv) Small rectangular rack in size measuring about 150mm x 200mm with round corners should be positioned above the toilet paper holder and at a height of about 900mm to 1200mm above the finished floor level (i.e. at the eye level of toilet users in a sitting position). The small rack should be of solid surfacing material (e.g. “Corian”, “Surrell” or other similar materials) in a matching colour with vanity benchtop or WC compartment.
- (v) Toilet paper holder
- (vi) Wall-mounted sanitary disposal bin (for female WC compartment only) of recess type installed at the rear

3.3.12 Water cisterns and related piping should be concealed by panels, leaving appropriate space/ access openings behind for installation of the disinfecting devices/ future maintenance. If water cisterns are only partially concealed by flat platforms placed on top, slanted ledges (with an angle of about 45°) should be added.



Coat hook with cover/ledge



Small rack above toilet paper holder



Toilet paper holder



Recess-type sanitary disposal bin



Cistern and related piping are concealed from view, leaving the toilet cubicle clean and tidy

*Kwai Fong Station Bus Terminus
Public Toilet (Kwai Tsing)*



Slanted ledge covering water cistern

*Lei Yue Mun (Ling Nam Sun Tsuen)
Public Toilet (Kwun Tong)*

3.3.13 WC compartments located at dead ends should be avoided where possible for security reasons.

3.4 Baby Rest

3.4.1 Baby rest should be installed in at least one female cubicle if site conditions permit. If there is enough space, provision of a baby rest in one male WC cubicle and the accessible unisex toilet may be considered. The actual provision should depend on site condition, space availability, usage pattern and operational need.

3.4.2 The baby rest should be installed inside a pedestal cubicle, the size of which should be suitably enlarged.

3.4.3 The baby rest of a floor standing type with a fixed front guard should be securely affixed to the floor and the wall/ the toilet compartment partition.

(Please refer to photos under para. 6.20)

Urinals in Male Toilets

3.5 Provision of Urinals in Male Toilets

- 3.5.1 Ceramic urinal bowls (about 580mm to 620mm above finished floor level) with modesty boards should be provided.
- 3.5.2 The modesty board separating each urinal should be of adequate size for addressing sightline and privacy concerns.
- 3.5.3 One accessible urinal in compliance with the requirements of the prevailing “Design Manual - Barrier Free Access” should be provided for use by persons with ambulant disabilities, the elderly and children when more than one urinal is provided, unless there is space or other constraints.
- 3.5.4 When eight or more urinals are provided (including the accessible urinal), provision of one children-height (with a front rim not higher than 400mm) or one elderly (with hand-grip railing installed) urinal may be considered on a case-by-case basis depending on site condition, space availability, usage pattern and operational need.
- 3.5.5 The vertical grab rail for the accessible urinal and hand-grip railing for elderly urinal should be in white colour coating similar to those in WC compartments.
- 3.5.6 A shelf / rack above the urinals of about 100mm in depth for putting personal belongings should be provided. The shelf / rack should be made of the same material of the vanity benchtop and of matching colour.
- 3.5.7 Cisterns of the urinals and the related piping should be concealed as far as practicable, leaving appropriate space / access openings for installation of the disinfecting devices / to facilitate future maintenance.



*Kwai Fong Station Bus Terminus Public Toilet
(Kwai Tsing)*



Hand-grip railing to facilitate the elderly and health impaired person

Elderly urinal

Tai Po Centre Public Toilet (Tai Po)

Flushing System


3.6 Flushing System for Toilet Compartments and Urinals

- 3.6.1 If site conditions permit, valve-type flushing system should be used. The flushing valves should be a model and type approved by Water Supplies Department. The related piping for the flushing system should be concealed.
- 3.6.2 For toilets where installation of flushing valves is found infeasible, water cisterns and the related piping should be concealed from view.
- 3.6.3 Sensor type flushing system should be installed in the WC cubicles and at urinal bowls if site conditions permit. Flushing sensors should be equipped with an overriding manual button so that manual flushing could be effected in case of malfunctioning of the flushing sensor.
- 3.6.4 If no sensor type flushing system could be provided for WC cubicles, provision of button-type flushing device operated by hand is preferred over foot pedal device.
- 3.6.5 If site conditions do not permit installation of sensor type flushing system at urinal bowls, auto-flushing system should be adopted and set to flush at an appropriate frequency subject to the usage rate, type of flushing water and type of sewer treatment system (e.g. at every 10 - 15 minutes if fresh water is used for flushing or if holding tanks for temporary storage of waste/ bio-treatment system is used).

- 3.6.6 Flushing water for urinal bowls should be by means of individual sparge outlets, specifically designed for the selected brand of urinal, to ensure full flushing over the entire inner surface without spillage onto the surrounding floor.



Mei Foo Sun Chuen Bus Terminus Public Toilet (Sham Shui Po)

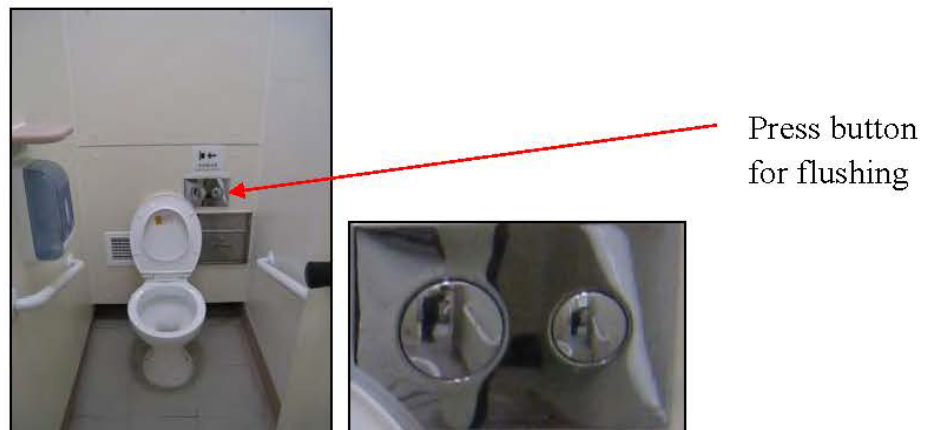

Stanley Main Street Public Toilet (Southern)

Accessible Unisex Toilet

- 3.7 Provision of accessible unisex toilet should comply with the requirements in the prevailing “Design Manual – Barrier Free Access” issued by Buildings Department and other legislations and codes of practice relating to barrier free access.
- 3.8 Accessible unisex toilet for use by persons of both sexes and access to which does not necessitate traversing an area reserved for one sex should be provided. The toilet should, where possible, be accessible from a public corridor or directly from outside the building so that the toilet can be used by persons with a disability, wheelchair users, the elderly and the elderly with frailty, etc., with assistance from members of either sex if necessary.



Accessible unisex toilet

Tui Min Hoi (Chui Tong) Public Toilet (Sai Kung)



Tai Po Centre Public Toilet (Tai Po)

- 3.9 Coat hook, small rack, toilet paper holder, electric hand dryer, litter bin, hand sanitizer and other small fittings available in male and female toilets, should be provided and positioned suitably for use by wheelchair users.
- 3.10 An emergency call bell, with audible signal and red warning light signal, should be provided at the accessible unisex toilet. To minimize nuisance to nearby residents, the alarm system should be provided with a manually reset function (without keys) and an automatic device which stops the audible signal not more than 15 minutes after activation. Once the alarm system is activated, the red warning light signal should remain on until the alarm system is reset.



Emergency call bell, with audible signal and red warning light signal, above the entrance of the accessible unisex toilet

*Lei Yue Mun (Ling Nam Sun Tsuen) Public Toilet
(Kwun Tong)*

- 3.11 Door fastening of the accessible unisex toilet should be capable of being released from the outside in the event of an emergency. The door/ door fastening shall be equipped with push-type or lever-type handle (capable of being easily opened/ closed by one hand) and an indicator bolt for indicating whether the toilet is occupied/ vacant in color. The door should also be designed to swing outward unobstructively.
- 3.12 Consideration may be given to installing an alarm that would be activated when the door is opened from the outside when the toilet is in use and locked from the inside on a need basis. If the door fastening can be released with a coin from the outside, door alarm that would be activated once a “coin” is inserted to open the door from the outside could be adopted. (To minimize nuisance to nearby residents, the alarm system should be provided with a manually reset function (without keys) and an automatic device which stops the audible signal not more than 15 minutes after activation. Once the alarm system is activated, the red warning light signal should remain on until the alarm system is reset.)
- 3.13 In addition to the alarm provision or as an alternative, a warning notice shall be displayed to alert the public that it is an offence to enter the occupied accessible unisex toilet by forcible or improper means. The warning notice is set out as follows -

除緊急情況外，強行或以不當方法進入有人使用的廁格，最高可被罰款二千元。

UNLESS DURING AN EMERGENCY, ENTERING ANY OCCUPIED TOILET COMPARTMENT BY FORCIBLE OR IMPROPER MEANS IS LIABLE TO A MAXIMUM FINE OF \$2,000.



Door lock can be opened
with a coin from outside

*Lantau Link Viewing Platform
Public Toilet (Kwai Tsing)*



Door swings outward
unobstructively

*Tui Min Hoi (Chui Tong)
Public Toilet (Sai Kung)*

- 3.14 Water cisterns and related piping should be concealed by panels, leaving appropriate space/ access openings behind for installation of the disinfecting devices/ future maintenance.

CHAPTER 4

INTERNAL DESIGN OF PUBLIC TOILET – COMMUNAL AREA

Internal Fitting-out

4.1 Wash Hand Basin and Vanity Benchtap

- 4.1.1 Provision of wash hand basins shall be at the rate of one for every two WC cubicles. Additional wash hand basins shall be provided at the rate of about one for every two urinal bowls at male toilet. In any case, at least one wash hand basin should be provided in each male and female toilet.
- 4.1.2 Normally, wash hand basins should be installed at about 850mm from finished floor level at the maximum.
- 4.1.3 If more than two wash hand basins are provided, one of them should be at children-height level, i.e. around 615mm to 635mm from finished floor level. The water tap and the soap dispenser should be suitably positioned at the side of the wash hand basin within easy reach of children.
- 4.1.4 Wash hand basins made of solid surfacing material (e.g. “Corian”, “Surrell” or other similar materials same as vanity benchtap) should be incorporated in vanity benches, fabricated as a single unit. Stainless steel wash hand basins should be avoided.
- 4.1.5 Vanity benchtap should be made of solid surfacing material (e.g. “Corian”, “Surrell” or other similar materials). Straight edge vanity benchtap (rectangular shape) with round corners is preferred to one with curved-edged fitted into each wash hand basin. Vanity benchtap with sharp corners should be avoided.
- 4.1.6 Back splash without joints should be provided.
- 4.1.7 Apron edge should be provided to prevent spillage of water onto the floor.
- 4.1.8 For wash hand basins provided outside the toilet premises, trough type basin with 2 to 3 taps at suitable intervals should be adopted. Wash hand basins similar to those provided inside the toilet should be avoided. Design of the wash hand trough should match with the surroundings of the toilet.

Apron edge to prevent spillage of water onto the floor

Children-height wash hand basin

Vanity benchtop with round corner

Back splash without joints



Kin Lung Street Public Toilet (Tuen Mun)

Vanity benchtop made of solid surfacing material

White-colour wash hand basin



Kam Tin Market Public Toilet (Yuen Long)



Wash hand trough outside the toilet premises

Sai Wan Public Toilet (Sai Kung) Chek Keng Public Toilet (Sai Kung)

4.2 Mirror

- 4.2.1 Glass mirror extended to the full length of the vanity benchtop should be provided. The frame of the mirror should be made of the same material of the vanity benchtop. Light colour or a colour matching with the vanity benchtop should be adopted for the mirror frame.
- 4.2.2 A light trough with suitable light fittings over each wash hand basin should be provided above the mirror. The light trough should be made of the same material of the vanity benchtop. Light colour or a colour matching with the vanity benchtop should be adopted for the light trough.
- 4.2.3 Same colour scheme should be adopted for the mirror frame and light trough.
- 4.2.4 A shelf (about 300mm – 350mm in depth), fixed to the wall above the vanity benchtop and below the mirror, should be provided for the full length of the vanity benchtop. The shelf should be made of the same material of the vanity benchtop and of matching colour.

Light trough with downlight over each wash hand basin

Frame of mirror



Glass mirror extended to the full length of the vanity benchtop

Lung Kong Road Public Toilet (Kowloon City)



Shelf provided for the full length of the vanity benchtop, with the benchtop setting forward

Tai Po Old Market Public Toilet (Tai Po)

4.3 Water Tap

- 4.3.1 Automatic infra-red sensor water taps operated by alternating current should be provided for male toilet, female toilet and accessible unisex toilet. An alternative water tap of hydro generator type with battery back-up may be considered. The water taps should be a model and type approved by Water Supplies Department.

- 4.3.2 The design and workmanship of the water taps should prevent splashing of water onto the vanity benchtop of wash hand basins. The design of infra-red sensor water taps should be user-friendly and standardized as far as circumstances warrant. They should be durable, fitted with sufficiently wide infra-red angle and with instant response in terms of reaction time.



Automatic
infra-red
sensor water
tap

Kin Lung Street Public Toilet (Tuen Mun)

- 4.3.3 The size of automatic infra-red sensor water taps provided in accessible unisex toilet should match with the size of the wash hand basin and in usual circumstances, a smaller sized water tap should be used. Where it is not possible to provide infra-red sensor tap in accessible unisex toilet, lever control type water tap without spring loading should be installed. The water tap should not require tight grasping, pinching or twisting of the wrist.



Infra-red
sensor
water tap in
accessible
unisex
toilet

Mei Foo Sun Chuen Bus Terminus Public Toilet (Sham Shui Po)



Lever control type water tap in accessible unisex toilet

Tai Po Old Market Public Toilet (Tai Po)

4.3.4 For the wash hand trough provided outside toilet premises, consideration may be given to adopting T-shape press release type water taps with modern design.

4.4 Soap Dispenser

4.4.1 Recess type soap dispenser should be provided for each wash hand basin and mounted on the vanity benchtop.



Soap dispenser (recess type)

Mei Foo Sun Chuen Bus Terminus Public Toilet (Sham Shui Po)

4.5 Make-up Corner

4.5.1 For public toilets at prime tourist spots, a make-up corner with a long stretch of vanity benchtop with mirror(s) and a seating bench should be provided in the female toilet, if space permits.



Make-up corner with a seating bench

Lantau Link Viewing Platform Public Toilet (Kwai Tsing)

- 4.5.2 If space permits, consideration may be given to providing a full-height mirror in the female toilet.
- 4.6 Baby Changing Counter and Baby Changing Room
 - 4.6.1 A baby changing counter should be provided in male toilet and female toilet respectively, unless site conditions do not permit. Provision of a baby changing counter in the accessible unisex toilet may be considered subject to site condition, space availability, usage pattern and operational need.
 - 4.6.2 Folding baby changing counter should be provided as far as practicable. Models without napkin holder is preferable.
 - 4.6.3 If space warrants provision of a fixed baby changing counter, provision of a soft pad on top of hard supporting surface may be considered. The soft pad, however, should be removable for cleansing purpose. Sharp corners should also be avoided.
 - 4.6.4 The length of fixed baby changing counter should not be too long. If space permits, consideration should be given to installing a seating bench or a foldable chair.
 - 4.6.5 If the fixed baby changing counter is an extension of the vanity benchtop, a low height partition between the baby changing counter and the wash hand basins should be provided to prevent water from splashing to the baby changing counter.



Folding baby changing counter with indicative sign above

Kam Tin Bor Tei Public Toilet (Yuen Long)



Provision of napkin holder should be avoided



Low-height partition to prevent the counter from getting wet

Soft pad

Fixed baby changing counter with indicative sign above

Peak Tower Public Toilet (Central/Western)

- 4.6.6 A separate baby changing room may be provided if space permits. If such room is provided, it should be equipped with a wash hand basin with vanity benchtop, a seating bench or a foldable chair, a lockable jumbo roll toilet paper holder, a litter bin and an emergency call bell. (To minimize nuisance to nearby residents, the alarm system should be provided with a manually reset function (without keys) and an automatic device which stops the audible signal not more than 15 minutes after activation. Once the alarm system is activated, the red warning light signal should remain on until the alarm system is reset.) The door of the room should be similar to the one provided for accessible unisex toilet and can be opened from outside in case of emergency. The door should also not be too heavy to facilitate user carrying a baby.



Ngong Ping Road Interchange Public Toilet (Islands)

- 4.7 Attendant Room
- 4.7.1 A small cubicle (floor area approximately 3m² if space permits) should be provided in each male toilet and female toilet for the attendant / cleansing staff.
- 4.7.2 Generally, solid-core wooden door (instead of hollow door) with mortise lock operated by key externally and thumb-turn internally should be provided for attendant room for security reason. If metal door is used instead, close shackle padlock (instead of open shackle padlock) should be used.
- 4.7.3 Each attendant room should be provided with a viewing panel with tempered clear glass (or a viewing panel on the door) to facilitate the toilet attendant to keep a vigilant watch over the toilet area.



Viewing panel
on the door of
attendant
room

Lantau Link Viewing Platform Public Toilet (Kwai Tsing)

- 4.7.4 A 13amp power point and an oscillating fan should be provided inside the attendant room.
- 4.7.5 A key box should be provided inside the attendant room.



Mortise lock for wooden door



Close shackle for metal door

4.8 Slop Sink / Mop Sink

- 4.8.1 A slop sink / mop sink housed inside a compartment should be provided inside each male toilet and female toilet as far as practicable. The slop sink / mop sink should not be exposed in the toilet circulation area.
- 4.8.2 The designated compartment for slop sink should have storage facilities like racks to allow storage of cleansing gear therein.
- 4.8.3 For toilets provided with attendant rooms, the slop sink / mop sink may be housed inside the attendant rooms.

- 4.8.4 If space does not permit, the slop sink / mop sink may be accommodated inside a tailor-made cabinet in the toilet, a compartment outside the toilet premises or may be replaced by provision of lockable water tap underneath the wash hand basin.



Slop sink and storage facilities inside a compartment

Tat Tung Road Public Toilet (Islands)



Slop sink in a tailor-made cabinet

Tsim Sha Shui Ferry Concourse Public Toilet (Yau Tsim)



Slop sink in a compartment outside the toilet premises

*Shing Mun Road Public Toilet
(Tsuen Wan)*

*Lau Fau Shan Roundabout Public
Toilet (Yuen Long)*

4.9 Other Provision

4.9.1 The following small fittings should be provided in communal area –

- (i) Electric hand dryers, preferably with automatic sensor controlled operation

They should be placed as close to the wash hand basins as practicable. At least one electric hand dryer should be provided at each of female and male toilet. The need to provide more than one electric hand dryer should be assessed case-by-case having regard to the no. of wash hand basins and the layout of the toilet.



Electric hand dryer

*Siu Lek Yuen Village Public Toilet
(Sha Tin)*

*Tseung Kwan O Industrial Estate
Public Toilet (Sai Kung)*

- (ii) Litter bins matching with the environment

They should not be placed immediately under hand dryers and should not cause obstruction to the users.

- (iii) Lockable jumbo roll toilet paper holder



Litter bin (wall-mounted)



Lockable jumbo roll toilet paper holder in communal area

*Ta Chuen Ping Street Public Toilet
(Kwai Tsing)*

*Sheung On Street Public Toilet
(Eastern)*

- (iv) Aesthetic holders for small planters at a suitable height
- (v) Hand sanitizer of manual-operated type (with refill of hand-gel based antiseptic solution)

Electric hand dryers, litter bins, lockable jumbo roll toilet paper holder and hand sanitizer should be positioned at 1200mm to facilitate both adult and children.

4.9.2 Emergency call bell, with audible signal and red warning light signal, should be installed in communal area in both male and female toilets. To minimize nuisance to nearby residents, the alarm system should be provided with a manually reset function (without keys) and an automatic device which stops the audible signal not more than 15 minutes after its activation. Once the alarm system has been activated, the red warning light signal should remain on until the alarm system is reset.



Siu Lek Yuen Village Public Toilet (Sha Tin)

- 4.9.3 Conduits and a 13 amp power point (power point to be provided at the attendant room) should be provided to pave way for the broadcasting of music and educational messages at public toilets with high usage rates or located in popular scenic areas/ hot tourist spots that are stationed by toilet attendants. The conduits provided should facilitate the cable connection for installation of a separate motion sensor near the entrance of male and female toilets for control of the broadcasting of music and educational messages.
- 4.9.4 Water-proof power sockets should be provided to facilitate operation of cleansing equipment by cleansing contractors.
- 4.9.5 Cage for housing mosquito trap (about 460mm (L) x 450mm (W) x 300mm (D)) should be installed at a high level for public toilets in rural area or public toilets in urban area with mosquito problem. Water-proof power socket should be provided for the mosquito trap.



Cage for mosquito trap at a high level

Tui Min Hoi (Chui Tong) Public Toilet (Sai Kung)

- 4.9.6 A Cleansing Inspection Register / Box preferably installed with a padlock should be provided.
- 4.9.7 There is no need to provide gates or doors at the respective main entrances to male toilet and female toilet unless otherwise specified. Instead, eyelets should be provided at the two sides of the entrances for hanging of chain or notice for temporary closure of toilet in case of need.

Internal Finishing and Colour Scheme

4.10 Wall

- 4.10.1 Large wall tiles (preferably not less than 300mm x 300mm) with matt finishes should be used, as far as practicable.
- 4.10.2 If dado/ border wall tiles are adopted, their dimensions should be aligned with the background wall tiles. If upper and lower portions of wall tiles with different colours are adopted, same wall tile dimensions should be adopted.
- 4.10.3 Wall tiles should preferably be fitted up to the ceiling. Otherwise, light-colour paint that is easy to maintain should be used for the top portion of the wall surface.

4.11 Floor

- 4.11.1 Coloured and large floor tiles (not less than 300mm x 300mm) should be used to minimize the number of joints. They should also be non-slippery (with slip-resistance valuation group R10 or equivalent), low-water absorbent and easy for cleansing.
- 4.11.2 Grouting between floor tiles should be proprietary type and low water absorbent to improve waterproofing and be effectively sealed.
- 4.11.3 Skirting tiles should match the selected floor tiles and shall be minimum 100mm high with coving at the junction of the floor and the wall.
- 4.11.4 Non-slippery nosing tiles with a distinctive colour and round edge should be installed along the step in front of raised floor area for safety reason.



*Lau Fau Shan Roundabout Public Toilet
(Yuen Long)*

Skirting tiles should match the selected floor tiles and shall be minimum 100mm high with coving at the junction of the floor and the wall

4.12 Ceiling

4.12.1 Light-colour paint that is easy to maintain can be used for ceiling surface. False ceiling should be avoided for easy cleansing and maintenance.

4.12.2 Junctions of floor tiles and wall tiles should be coved.

4.13 Internal Colour Scheme

4.13.1 Bright / Light colour scheme should be used to create a pleasant environment.

Example (1) : - Use of bright colour scheme for male and female toilets to produce a healthy, clean and pleasing atmosphere



Female Toilet

Male Toilet

Anchor Street Playground Public Toilet (Mong Kok)



Female Toilet



Male Toilet

Pok Man Street Public Toilet (Mong Kok)



Female Toilet



Male Toilet

Mei Foo Sun Chuen Bus Terminus Public Toilet (Sham Shui Po)

Example (2) :- Use of feature wall tiles at toilet entrances to highlight male and female toilets



Female Toilet



Male Toilet

Apleichau Municipal Services Building Public Toilet (Southern)

Materials with Properties that Can Retard Bacteria Growth

- 4.14 Consideration may be given to using materials with properties that can retard the growth of bacteria or materials with similar performance (e.g. materials of low water absorbent properties) for the wall and floor tiles, WC pans, wash hand basins, etc., in particular, in public toilets of high / medium usage rate.

Lighting

- 4.15 Sky light and light reflection panels should be introduced to bring in natural lighting.



Use of sky light to bring in natural lighting

San Hing Back Street Public Toilet (Islands)



Glass panel to allow for natural lighting

Kowloon Tong Public Transport Interchange Public Toilet (Kowloon City)

- 4.16 Energy efficient fluorescent tubes with electronic ballasts should be adopted (e.g. the prevailing type is T5).
- 4.17 For toilet with relatively low usage rate, motion sensor may be provided for the control of artificial illumination for energy saving.



Motion sensor control installed inside toilet

Liu To Village Public Toilet (Kwai Tsing)

Sightlines

- 4.18 Care should be exercised in the design to ensure that there are no unobstructed sight lines via doorways, windows, sky lights, ventilation openings from outside into the toilet areas. Sightline problem caused by reflection of mirrors should also be avoided.
- 4.19 In case a screen wall is required to rectify the sightline problem, light colour scheme should be adopted for the panel and frame of the screen wall. Graphic design on the screen wall may be considered subject to the location of the public toilet.
- 4.20 Both ends of the service corridor shall be properly guarded to prevent the public from seeing through the corridor.



Screen wall

Lantau Link Viewing Platform Public Toilet (Kwai Tsing)



Screen wall

Tseung Kwan O Industrial Estate Public Toilet (Sai Kung)

Service Passage or Walk-in Services Ducts

- 4.21 Service passage or walk-in services ducts behind WC compartments should be provided if site conditions permit. Access for service passage or walk-in services ducts should be provided outside the toilets or through the male toilet.
- 4.22 If site conditions do not permit (e.g. due to limited space), consideration may be given to dispensing with the service corridor. In such cases, water cisterns and service and drainage pipes should be concealed behind removable panel fully compatible with the design of the toilet cubicle partitions.

CHAPTER 5

DRAINAGE AND VENTILATION

Prevention of Wet Floors


5.1 Blower Fan

- 5.1.1 Blower fans, preferably one for one to two wash hand basins, should be provided beneath the vanity benchtop to assist evaporation of moisture. Cover for the blower fans should be of louvre type or perforated to facilitate air circulation.



Blower fans
underneath
wash hand
basins

Pak Shing Street Public Toilet cum Bathhouse (Tai Po)

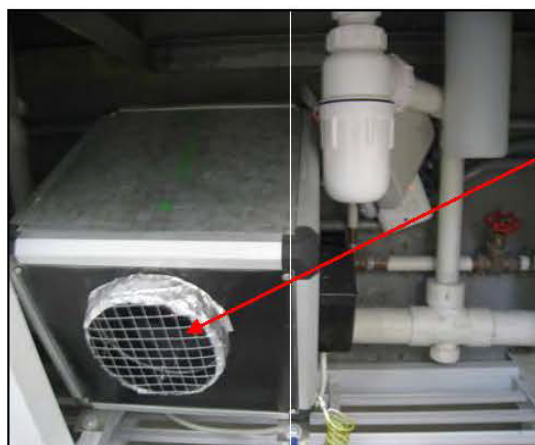

Blower fan

Lung Kong Road Public Toilet (Kowloon City)

5.2 Drainage

5.2.1 Adequate floor drains should be provided. In particular, surface channel with movable matching slab cover or dish channel should be provided at the following areas-

- (i) Along the front of WC compartment.
- (ii) Under the wash-hand basins, extending the full width of the range of basins and located about 200mm away from the wall to which the basins are fixed.
- (iii) Under the urinals, extending the full width of the range of urinals and located about 300mm away from the wall to which the urinals are fixed.
- (iv) In the front of the entrance to the toilet (only surface channel with movable matching slab cover should be provided).


5.2.2 The interior floor should be provided with a noticeable fall gradient for quick direction of water to dish/surface channels.

5.2.3 All surface channels should be covered with movable slab cover of up-to-date design and with the same floor tiles selected as far as circumstances warrant. Hole in channel cover and slot of gratings should comply with the requirements in the prevailing “Design Manual – Barrier Free Access” issued by Buildings Department. Stainless steel grating cover should be avoided.



Surface channel with matching cover using the same floor tiles selected

Mei Foo Sun Chuen Bus Terminus Public Toilet (Sham Shui Po)

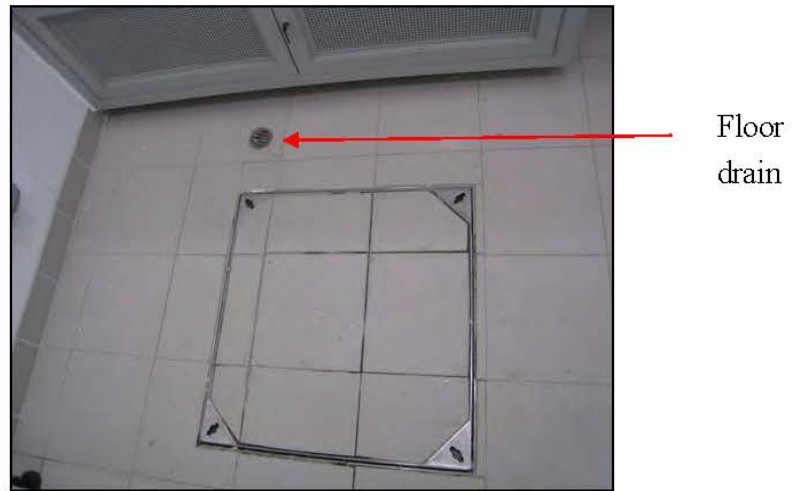

Siu Lek Yuen Village Public Toilet (Sha Tin)

Ventilation and Odour Control

5.3 Ventilation

- 5.3.1 Large-size opening and fixed louvre system or raised / extended roofing design should be adopted to enhance natural ventilation as far as practicable.
- 5.3.2 Louvre-type windows with large fins of durable materials such as aluminum / tempered glass / fibre glass of modern design should be provided at high level openings. Old style louvre windows with small wired glass fins should be avoided.



Lei Yue Mun (Ling Nam Sun Tsuen) Public Toilet (Kwun Tong)



Louvre-type windows with fins of tempered glass of modern design


Man Fai Street Public Toilet (Central/Western)

5.3.3 Mechanical ventilation system should be suitably designed and installed to provide adequate air exchange on top of natural ventilation.

5.4 Odour Control

5.4.1 Odour source oriented air exhaust fans should be provided in WC compartments for even air change and immediate odour removal whenever circumstances warrant. Air exhaust fans should be positioned at low level near odour source at about 150mm above the finished floor level.

5.4.2 The point of external discharge should be suitably positioned at high level and away from public areas.

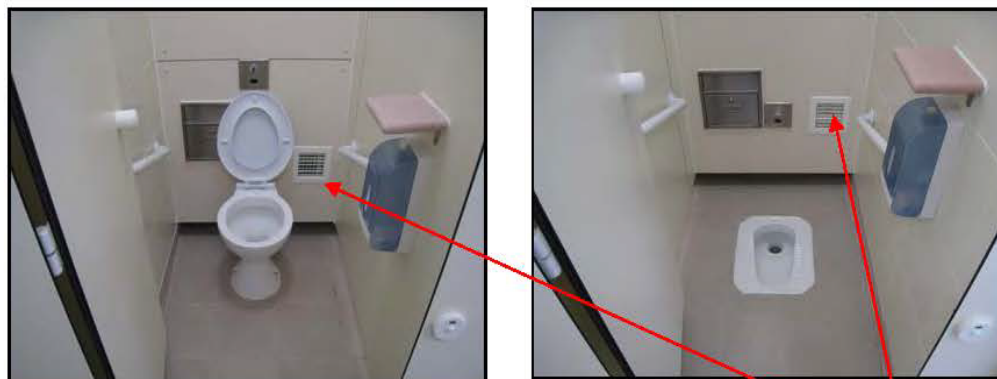

Kam Tin Bor Tei Public Toilet (Yuen Long)

Air exhaust fan at low level near odour source

5.4.3 An exhaust system should be provided above urinals to improve ventilation.



Air exhaust fan near odour source

Kam Tin Bor Tei Public Toilet (Yuen Long)



Exhaust system above urinals

Kei Yip Street Public Toilet (Kwun Tong)

5.5 Others

- 5.5.1 Oscillating / Wall-mount fans at a high level should be provided in the communal area.



Oscillating fan at communal area to facilitate air circulation

Nam Cheong Street Public Toilet (Sham Shui Po)



Wall-mount fan
at a high level

Kam Tin Bor Tei Public Toilet (Yuen Long)

5.5.2 Automatic air-refresheners should be provided.



Air-refreshener

Yan King Road Bus Terminus Public Toilet (Sai Kung)

CHAPTER 6

SIGNAGE

Toilet Title on External Wall

- 6.1 A toilet title sign, bearing the FEHD's logo (on the left-hand side of the Chinese and English toilet titles), should be displayed at the external wall of public toilet. The sign should be easily replaced without damaging the wall surface.
- 6.2 For toilet premises with bathhouse facilities co-existing with toilet facilities, it is not necessary to put the word "Bathhouse" on the title sign.
- 6.3 The sign should be made of durable non-reflective material (such as aluminum with powder coating).
- 6.4 The toilet title, FEHD's logo and any thematic background of the toilet title sign should have durable colours which will not fade under exposure to sunlight.



*Nam Cheong Street Public Toilet
(Sham Shui Po)*



*Lok Ma Chau PTI Public Toilet
(Yuen Long)*



*Tuen Mun Ferry Pier Public Toilet
(Tuen Mun)*

Illuminated Sign Box / Wall-mounted Sign on External Wall

- 6.5 An illuminated sign, with the conventional international symbol of male, female or accessibility, should be provided at the respective entrances to male toilet, female toilet and accessible unisex toilet as appropriate. The sign should be eye-catching, aesthetically-designed and easily seen from various directions at all times.
- 6.6 A bilingual (Chinese and English) wall-mounted signage, comprising the words ‘男廁/MALE TOILET’, ‘女廁/FEMALE TOILET’ or ‘廁所/TOILET’ and conventional international symbol of male, female or accessibility as appropriate, should be provided at eye-level at the respective toilet entrances.



Illuminated sign box


Tai Po Old Market Public Toilet (Tai Po)



Illuminated sign box

Tai Po Centre Public Toilet (Tai Po)

- 6.7 Braille and tactile sign should be provided at the respective entrances to the male toilet, female toilet and accessible unisex toilet.
- 6.8 The illuminated sign, wall-mounted sign and braille and tactile sign should comply with the requirements in the prevailing “Design Manual – Barrier Free Access” issued by Buildings Department. The international symbol of accessibility shall be the wheelchair figure in white on a blue background.

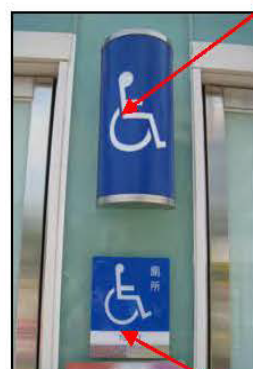

Illuminated sign box

Wall-mounted signage plate with Braille sign

Expo Drive East Public Toilet (Wanchai)

- 6.9 For male and female toilets provided with baby changing counters, it is not necessary to provide an additional sign for the counter outside the toilets. However, the sign for baby changing counter should be displayed outside the accessible unisex toilet provided with such a facility.



Sign for baby changing counter outside the toilet for accessible unisex toilet



Yip Fat Street Public Toilet (Southern)

- 6.10 If there is a baby changing room in the toilet, wall mounted signage plate should be provided outside the baby changing room.

Composite Sign

- 6.11 A bilingual (Chinese and English) composite sign comprising the FEHD logo and the following words and related symbols should be provided in communal area of male and female toilets and inside accessible unisex toilet -

- (i) 男廁 / 女廁 / 廁所 (*as appropriate*):
MALE TOILET / FEMALE TOILET / TOILET (*as appropriate*):
(Remarks : The above words and related symbols should be placed on the left hand side of the sign)
- (ii) 小心地滑
CAUTION : WET FLOOR
(Remarks : The characters' size should be relatively large to draw the attention of toilet users)
- (iii) 嚴禁吸烟
NO SMOKING
- (iv) 不准棄置報紙於廁盆
請放入垃圾箱
NO NEWSPAPER IN WATER CLOSET PANS
PLEASE USE LITTER BINS

- (v) 嚴禁取走公廁的水到別處使用
TAKING AWAY OF WATER FROM THE PUBLIC TOILET FOR USE ELSEWHERE IS PROHIBITED

- (vi) 如有投訴或意見請電 XXXX XXXX 或熱線電話 2868 0000
FOR COMPLAINTS OR SUGGESTIONS, PLEASE TELEPHONE : XXXX XXXX OR HOTLINE : 2868 0000
(Remarks : The telephone number 'xxxx xxxx' shall vary in different districts and, therefore, should be confirmed with district management in advance)



Composite sign

Tseng Tau Chung Tsuen Public Toilet (Tuen Mun)

[Note: Composite sign to be updated as according to para. 6.11]

Information Sign

6.12 A bilingual (Chinese and English) information sign should be provided for each of the following provisions for indicative purpose –

- (i) Automatic infra-red sensor water tap (“電子感應龍頭/ AUTOMATIC SENSOR TAP”) (The sign should also indicate the number of the wash hand basin to which the water tap is fixed for identification purpose. The number sign should not be conspicuous).
- (ii) Soap dispenser (“梘液/ LIQUID SOAP”)
- (iii) Emergency call button (“緊急召援/ EMERGENCY CALL” in Chinese, English and Braille in compliance with the requirements of the prevailing “Design Manual – Barrier Free Access”)

Number sign on the indicative sign for infra-red sensor water tap



Indicative sign for infra-red sensor water tap



Kam Tin Bor Tei Public Toilet (Yuen Long)



Indicative sign for soap dispenser

Kam Tin Bor Tei Public Toilet (Yuen Long)



Indicative sign for emergency call button

Expo Drive East Public Toilet (Wanchai)

- 6.13 A bilingual (Chinese and English) signage plate, comprising the words ‘使用後請沖廁/ PLEASE FLUSH AFTER USE’ and the number of the toilet compartment, should be provided inside each of the toilet compartments that are not installed with sensor type flushing system. The number sign should not be conspicuous.



Number sign on the signage plate for flushing

Nam Cheong Street Public Toilet (Sham Shui Po)

- 6.14 A bilingual (Chinese and English) signage plate, comprising the words “電子感應沖廁/AUTOMATIC SENSOR FLUSHING” and the number of the toilet compartment, should be provided inside each of the toilet compartments that are installed with sensor type flushing system.

- 6.15 A signage plate with a symbol for squatting or pedestal WC compartment should be provided at the front side of each WC compartment door for indicative purpose. The number sign should be arranged in sequence irrespective of the type of WC compartment.



Pedestal WC compartment



Squatting WC compartment

Siu Lek Yuen Village Public Toilet (Sha Tin)

- 6.16 The same number should be featured in the number sign on the signage plate for flushing and the signage plate for WC compartment.
- 6.17 Two acrylic poster holders of A-2 size for notice including the cleansing schedule and performance pledge should be provided in the accessible unisex toilet and at the communal area inside each male toilet and female toilet.



Acrylic
poster
holder of
A-2 size

Tseng Tau Chung Tsuen Public Toilet (Tuen Mun)

- 6.18 A number plate should be provided for each urinal bowl. However, it should not be conspicuous and preferably be installed beneath the urinal bowls.

Number plates beneath the urinal bowls



Lung Kong Road Public Toilet (Kowloon City)

- 6.19 A number plate should be provided for each wash hand basin. It should not be conspicuous and be aesthetically designed.
- 6.20 Proper indicative sign should be displayed on/provided next to the baby rest, and affixed to the door of toilet compartment provided with a baby rest to draw the attention of toilet users. Detailed and clear instructions in bilingual (Chinese and English) on how to use the baby rest should be posted next to the baby rest.



Baby rest with clear indicative sign

Tai Po Centre Public Toilet (Tai Po)



Baby rest (floor standing type with fixed front guard) in pedestal cubicle

Tai Po Centre Public Toilet (Tai Po)

- 6.21 A bilingual (Chinese and English) signage plate, comprising the words “嬰兒衛生間/BABY CHANGING COUNTER” and the conventional international symbol for such counter, should be displayed on / next to the baby changing counter (for both fixed or folding type baby changing counter).



Hung Cheung Road Public Toilet (Tuen Mun)

- 6.22 Simple instructions in English, Chinese and Braille (with appropriate illustrations) on how to unfold the grab rail should be affixed to the wall next to the folding grab rail adjacent to the water closet in the accessible unisex toilet.
- 6.23 A bilingual (Chinese and English) signage plate with the name of the utility room (e.g. ATTENDANT ROOM/值勤室, SLOP SINK ROOM/潔淨用品房, STORE ROOM/儲物室 etc.) should be provided at the door of each of these rooms.



*Hung Cheung Road Public Toilet
(Tuen Mun)*



*Ma Tin Pok Public Toilet
(Yuen Long)*



*Tui Min Hoi (Chui Tong) Public
Toilet (Sai Kung)*



*Lung Kong Road Public Toilet
(Kowloon City)*

- 6.24 Where appropriate, a bilingual (Chinese and English) warning sign with the words '小心地滑 / CAUTION : WET FLOOR' should be provided at suitable locations.



Lam Tei Market Public Toilet (Tuen Mun)

Others

- 6.25 Where appropriate, a directional sign, with or without illumination, should be provided at suitable locations outside the toilet to guide users to the male toilet, female toilet and accessible unisex toilet. Agreement of Highways Department may need to be sought for signs provided at road side.



Wan Chai Market Public Toilet (Wanchai)



Tai Hang Road Public Toilet (Wanchai)

- 6.26 All the signs/ illuminated sign boxes should be aesthetically designed. Use of stainless steel (reflective in nature), fragile materials and materials that are subject to corrosion should be avoided.
- 6.27 Chinese words/descriptions of all signage should be displayed on top of English ones.

Compliance with Barrier Free Access Requirements

- 6.28 Signs shall be erected to indicate clearly the exact locations of facilities available for use by persons with a disability in compliance with the requirements in the prevailing “Design Manual – Barrier Free Access” issued by Buildings Department, including provision of Braille and tactile information signs on the adjacent wall to indicate the presence of an opening for landings of staircase leading to an open space or the entrance/ exit of a building, provision of Braille and tactile information on directional arrow and floor number on handrail on every floor at designated location to facilitate persons with visual impairment.

APPENDIX

Points to Note for Construction / Reprovisioning / Refurbishment / Conversion Projects

1. The expenses for provision of portable toilets during works period should be absorbed by the funding of the concerned projects. For projects funded by Refurbishment Block Vote 3004GX, FEHD would indicate the requirement for portable toilets and provide justifications while initiating the projects to ArchSD. ArchSD should include the requirement in the funding application. For projects funded by Minor Building Works Block Vote 3101GX or other funding vote, FEHD should indicate the requirement for portable toilets in the Client Project Brief / Project Definition Statement concerned so that the related expenses can be included in the funding application.
2. For new construction, reprovisioning, refurbishment and conversion projects that are presented at pre-vetting or vetting meetings, works agent and the consultant should be responsible for ensuring that their designs should comply with prevailing requirements (statutory or non-statutory) promulgated by relevant government departments.
3. The following actions should be taken following site possession :
 - (i) The works contractor should display a notice on works programme and contact person, in a conspicuous place on-site, upon site possession in respect of construction / reprovisioning / refurbishment / conversion project.
 - (ii) The works contractor should email to the works department and FEHD a photo on the day of closure to demonstrate that requirement (i) above has been properly followed.
 - (iii) Hoarding should be erected the soonest possible after site possession to prevent the public from entering into the works site.
 - (iv) The works contractor should commence site works the soonest possible after site possession. If delay in works commencement is foreseeable, FEHD should be informed in advance. Where feasible, site possession should be arranged to tie in with the works commencement by the contractor.
 - (v) The works contractor should adhere to the works programme stated on the notice as far as practicable and to avoid unnecessary delay in works completion.

- (vi) The works contractor should keep the works department and FEHD informed if there is known delay in completion. The works completion date on the notice should also be updated accordingly.
- (vii) The works contractor should keep the works department and FEHD informed if there is suspension of works. A notice on the works suspension should be displayed.



Notice on works programme and contact person on site

**Design Guidelines for
Larger Toilet Compartments for Priority Use by the Elderly
and Universal Toilets in Public Toilets of FEHD**

(April 2016)

Outline

In response to Policy Address 2016 for providing larger toilet compartments for priority use by the elderly (priority compartments) and to address LegCo members' concern over the provision of unisex toilets on top of the statutory requirements, FEHD will provide priority compartments and universal toilet in **newly-built/refurbished public toilets where practicable** and the design features/layouts are set out below.

*** 委員會秘書附註： 本文件只備英文本。**

Larger Toilet Compartment for Priority Use by the Elderly

(a) **Subject to site condition and space availability** and where **four or more toilet compartments** in male *or* female toilets are provided, the **toilet compartment nearest to the entrance of both toilets** will be designated for priority use by the elderly;

(b) The number of priority compartment to be provided should be as follows -

No. of toilet compartment in male/female toilet	Provision of priority toilet compartment for the elderly
4 - 6	1
7 - 18	2
19 - 36	3
37 - 60	4
Above 60	5


(c) The toilet compartment will be **wider than a conventional one** and measures **1350mm wide** between the finished wall surfaces subject to actual site condition. In case of site constraint, minor downward adjustment to the 550mm-wide clear space by the side of the water closet in a range of 50mm - 100mm may be allowed, provided there is still adequate space for the placement of walking aids and/or the movement of the carer to provide the assistance needed;

(d) **Pedestal type water closet** will be provided;


(e) **Indicative signage** will be affixed outside the door of the toilet compartment; and


(f) **Other fittings**, including hand-grip rails, small rack and coat hook provided in a conventional toilet compartment will be provided in the priority compartment.


Larger Toilet Compartment for Priority Use by the Elderly
- Layout and Signage

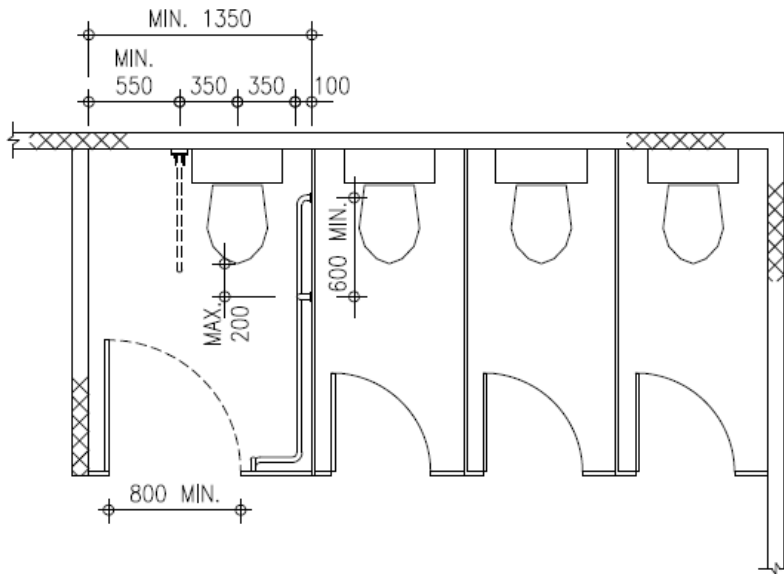


LEGEND ALL DIMENSIONS ARE IN mm.

 DOOR HARDWARE (INCLUDING LOCKS AND HINGE) SHOULD ALLOW READILY REMOVAL/ OUT-SWINGING OF THE DOOR IN CASE OF EMERGENCY.

 HORIZONTAL GRAB RAIL, DIA. 32-40 AT 725-750 H.

 FOLDABLE GRAB RAIL, 725-750 H.


 VERTICAL GRAB RAIL, DIA. 32-40 & L ≥ 600

Universal Toilet

- (a) **Subject to site condition and space availability** and where **four or more toilet compartments** in male *or* female toilets are provided, a separate universal toilet will be provided in the public toilet;
- (b) The universal toilet should be accessible directly from a public area that does not necessitate traversing an area reserved for one sex only, and access to which should be from a corridor so that it can be used by either sex with assistance from members of opposite sex, if necessary;
- (c) Only one universal toilet will be provided in the public toilet irrespective of the number of male/female toilet compartments. The universal toilet should normally be at ground floor level as far as the site condition and space availability permit. If not, it should be provided on the second floor or lower floor as far as practicable;
- (d) The internal area of a universal toilet should measure **2300mm wide and 1950mm long** between the finished wall surfaces;
- (e) **Pedestal type water closet** will be provided in the toilet;
- (f) **Indicative signage** will be affixed outside the door of toilet; and
- (g) **Other fittings** including hand-grip rails, flap-type diaper changing station, baby safety seat, children water closet, children friendly wash basin¹ and emergency call-bell will also be provided in toilet.

¹ **Flap-type diaper changing station, baby safety seat, children water closet, children friendly wash basin** mentioned in ArchSD's guidelines are referred to as **foldable baby changing counter, baby rest, child-height water closet and child-height wash hand basin** respectively in FEHD's "Handbook on Standard Features for Public Toilets".

Universal Toilet - Layout and Signage²

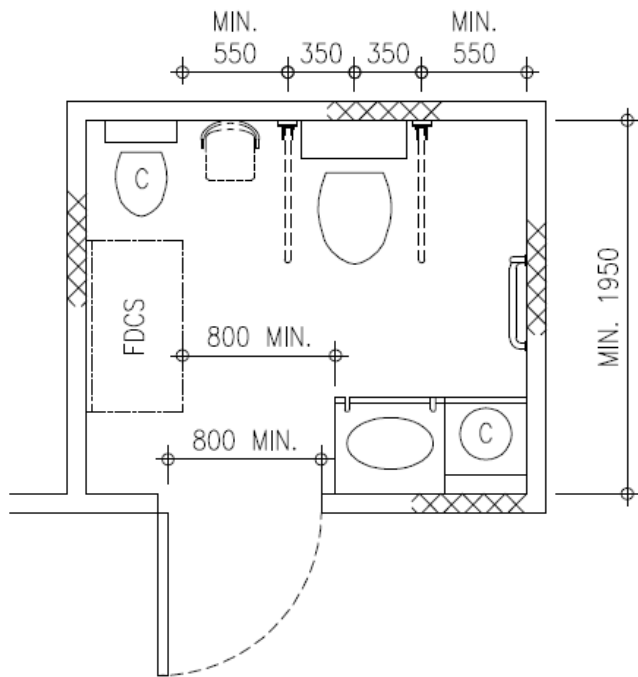

LEGEND ALL DIMENSIONS ARE IN mm.

 - SWING DOOR SHOULD BE OPENABLE OUTWARD

 VERTICAL GRAB RAIL,
DIA.32-40 & L>600

 FOLDABLE GRAB RAIL,
725-750 H.

 FDCS FLAP-TYPE DIAPER
CHANGING STATION
MIN.900x500

 WASH BASIN WITH
NOTCHES AT BASIN
COUNTER EDGE

 HORIZONTAL GRAB RAIL,
DIA. 32-40

 FLAP-TYPE BABY
SAFETY SEAT

 CHILDREN WC

 CHILDREN FRIENDLY
WASH BASIN

² The design of the signage for Universal Toilet is preliminary and **subject to further amendment.**

**Enhanced design features/requirements/installations
for new/refurbished public toilets
(Version 2)**

1. Automatic **sensor type soap dispenser** should be provided for each wash hand basin and mounted on vanity benchtop.
2. Use of **LED lighting** with replaceable light bulbs.
3. **Electric hand dryer** should be of powerful model capable of generating high velocity air-stream to dry hand **within 12 seconds**, with **noise reduction** and fitted with **drain tank**. **At least two hand dryers should be provided** at the communal area of the male and female toilet if site condition permits.
4. **Blower fan** of high drying speed (with timer control) fitted with **plate-shape air-boot** affixed to the air-outlets so that air stream will be blown downwards facing the floor at an angle less than 30° should be provided under the wash hand basin to assist evaporation of moisture.
5. **Timer** should be provided for control of all **fans including blower fans and lighting** for energy saving purpose.
6. Provision of **wall mounted stall-type urinal** with the bottle trap and associated piping concealed behind the lower part of the urinal while the trap should be reachable for ease of cleansing and maintenance.
7. Provision of lockable **stainless steel jumbo roll toilet paper holder** in individual compartments. **No jumbo roll paper holder shall be installed in communal area.**
8. Use of **larger** (600mm x 600mm preferably), non-slippery (R10) **floor tiles** for toilets of medium or larger size. **Wall tiles** shall be of size 600mm x 300mm to tally with the use of larger floor tiles. Finishes and colour scheme should be carefully developed with a view to create a clean and pleasant atmosphere.

*委員會秘書附註：本文件只備英文本。

9. **Water-proof power sockets** with by-pass switch should be provided in the communal area of toilets (at least two numbers each in Male, Female and Accessible Unisex Toilets (lockable) depending on the floor area and layout) and attendant rooms (two numbers each) to facilitate operation of cleansing equipment and electrical appliances.
10. For new toilets where there is flexibility in laying out the services, **manhole covers** should be sited away from toilet entrances and conspicuous locations as far as possible to mitigate visual impact.
11. Both pedestal and squatting types water closets should be provided but pedestal types should be provided predominantly in view of the increasing demand arising from the aging population. Generally, while at least 1 pedestal water closet should be provided in each of the male and female toilets having 1 to 2 water closets, the **ratio of 3 pedestal type water closets to 1 squatting type closet** should be adopted in each of the male and female toilet having 3 or more water closets unless otherwise specified. The actual number of pedestal and squatting type water closets should depend on site condition, space availability, usage pattern, operational needs and the special requirements of the majority of target toilet users.
12. **Drinking water dispenser** will be installed as far as possible at the external part of the PT with cover when a new/reprovisioned PT is constructed or an existing PT is refurbished. Feasibility for installation of drinking water dispenser at each PT should be further assessed on an individual basis subject to site condition (whether there is adequate space for the installation at the external part of PT within its site boundary) and technical feasibility (availability of potable water supply and approval from Water Supplies Department on the installation application)

Food and Environmental Hygiene Department
August 2018

過去 5 年(2015-16 至 2019-20 年度)
新建／重置／翻新公廁的數目詳情

年度	新建公廁數目	重置公廁數目	翻新公廁數目
2015-16	1	0	19
2016-17	2	2	7
2017-18	4	1	9
2018-19	7	7	11
2019-20 (截至 5.12.2019)	0	0	27
總計	14	10	73

不設自動感應式視液機、水龍頭和沖廁系統的公廁

分區	不設以下自動設施的公廁數目		
	視液機	水龍頭	沖廁系統
中西區	33	12	22
灣仔	15	1	14
東區	13	3	6
南區	19	2	7
油尖旺	13	0	9
深水埗	6	0	1
九龍城	13	1	8
黃大仙	5	1	1
觀塘	9	0	3
荃灣	28	2	23
屯門	44	0	42
元朗	178	8	156
北區	132	4	99
大埔	70	6	61
西貢	54	12	46
沙田	26	9	23
葵青	12	0	8
離島	60	7	52
總計	730	68	581

設有自動感應式水龍頭的旱廁

分區	旱廁數目
屯門	1
元朗	3
北區	2
西貢	2
葵青	1
離島	1
總計	10

過去 5 年的公廁罪案舉報數字

地區	罪行種類	財政年度內的罪案舉報數字					總計
		2014 - 2015	2015 - 2016	2016 - 2017	2017 - 2018	2018 - 2019	
中西區	惡意破壞	0	0	0	1	2	3
灣仔	裝置被盜	0	0	0	1	0	1
油尖	惡意破壞	0	0	0	1	5	6
	裝置被盜	0	0	0	0	5	5
旺角	惡意破壞	0	0	0	0	2	2
	裝置被盜	0	0	0	0	3	3
觀塘	惡意破壞	0	0	1	0	0	1
葵青	惡意破壞	1	0	0	1	3	5
	裝置被盜	1	1	0	1	5	8
大埔	塗鴉	0	1	0	0	0	1
	非法取水	0	0	1	0	0	1
沙田	惡意破壞	0	0	1	1	3	5
	裝置被盜	0	0	0	0	3	3
北區	裝置被盜	1	0	0	0	3	4
西貢	裝置被盜	0	0	0	0	1	1
屯門	惡意破壞	0	1	2	0	14	17
	裝置被盜	5	3	1	0	5	14
元朗	惡意破壞	0	0	0	6	2	8
	裝置被盜	1	0	1	0	13	15
離島	惡意破壞	0	0	0	0	3	3
	裝置被盜	1	0	0	0	2	3
黃大仙	裝置被盜	0	0	0	0	3	3
案件總數		10	6	7	12	77	112

食環署員工及承辦商提供潔淨服務公廁的巡查指引

提供公廁潔淨服務的單位	巡查指引
食環署員工	請參閱 <u>附件 7a</u> 。
承辦商	請參閱 <u>附件 7b</u> 。

摘自《潔淨服務工作守則》項目 5 的附件 I

食環署員工提供的潔淨服務

巡查次數

設施/服務	管工
設於人口眾多的鄉村/地區的公廁及公共浴室	每更一次
設於偏遠地區*的旱廁及公廁	每周一次

- * 偏遠地區的例子包括沒有車輛通道或位於偏遠離島的地點。高級衛生督察(潔淨及防治蟲鼠)可按每宗個案的實際情況行使酌情權，決定有關設施是否位於“偏遠地區”。

摘自《公眾潔淨服務合約管理工作守則》的附件 VII

管理公眾潔淨服務合約

高級管工(合約管理)的巡查指引

需巡查的服務範疇 / 設施	次數 / 範圍
有廁所服務員值勤的沖水式廁所 公共浴室	每個工作更次巡查最少一次。 ^{註 1}
無廁所服務員值勤的沖水式廁所	每隔一個工作天巡查最少一次。 ^{註 1}

註 1: 有關偏遠地區的設施，高級衛生督察(潔淨防治蟲鼠)可酌情決定最合適的最少巡查次數。

34 份生效中的外判街道潔淨服務合約收到的標書數目

截至 2019 年 12 月 1 日

收到的標書數目	涉及外判街道潔淨服務合約的 數目
2	1
3	4
4	12
5	11
6	6
總計	34